
















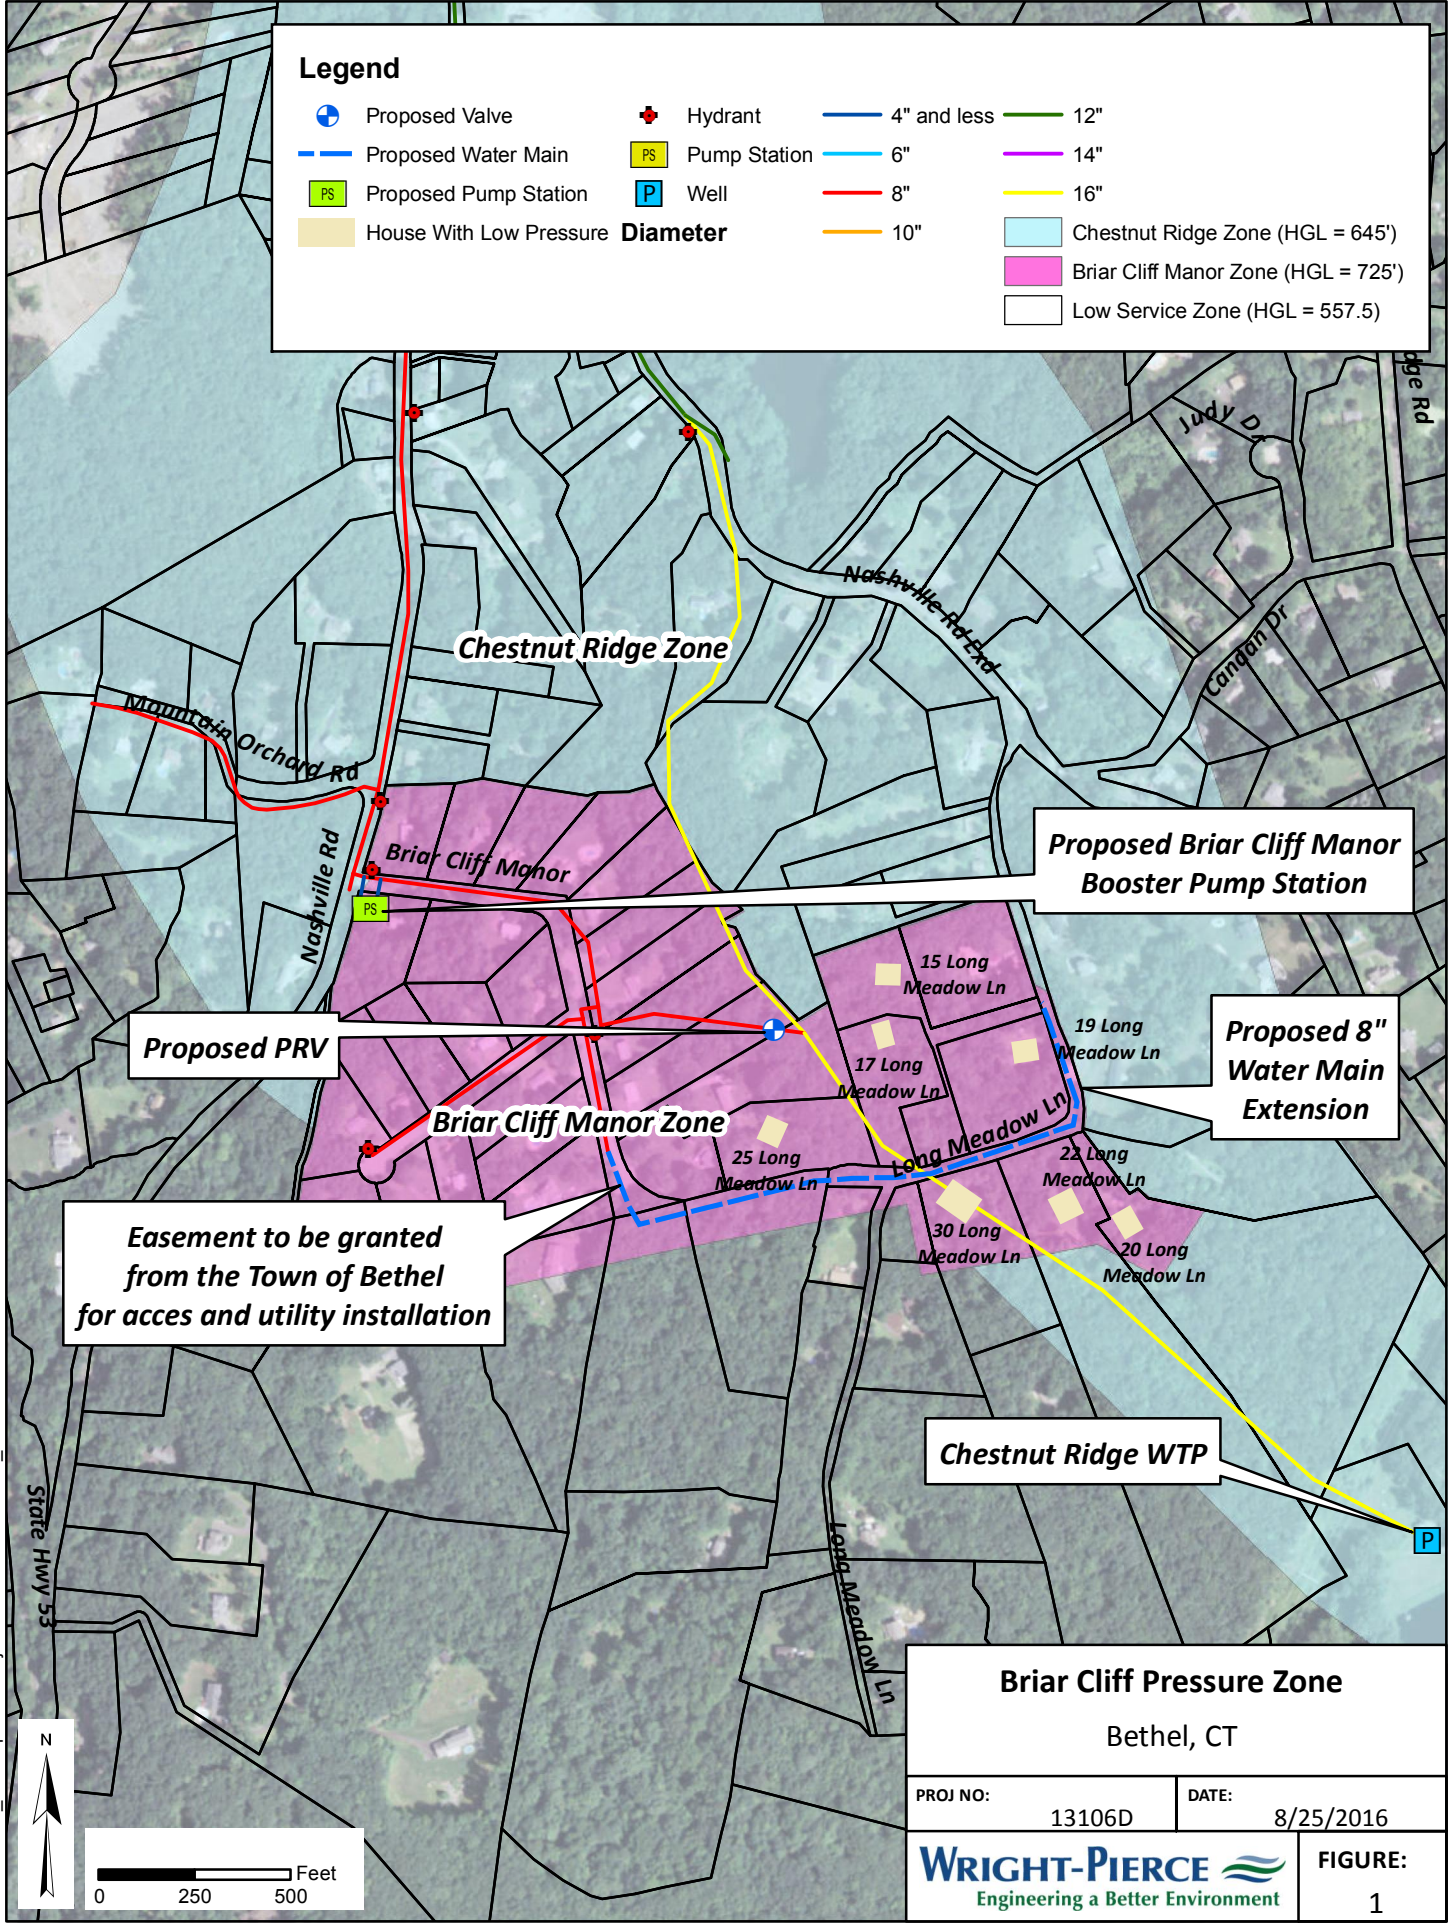


TAH W:\GIS_Development\Projects\CT\Bethel\13106D_GeneralServices\MXD\BriarCliffManor\Zone2-8x11-P.mxd

Legend

-  Proposed Valve
-  Proposed Water Main
-  Proposed Pump Station
-  House With Low Pressure
-  Hydrant
-  Pump Station
-  Well
- Diameter**
-  4" and less
-  6"
-  8"
-  10"
-  12"
-  14"
-  16"
-  Chestnut Ridge Zone (HGL = 645')
-  Briar Cliff Manor Zone (HGL = 725')
-  Low Service Zone (HGL = 557.5)



Proposed PRV


**Proposed Briar Cliff Manor
Booster Pump Station**

**Proposed 8"
Water Main
Extension**

**Easement to be granted
from the Town of Bethel
for acces and utility installation**

Chestnut Ridge WTP

Briar Cliff Pressure Zone
Bethel, CT

PROJ NO: 13106D	DATE: 8/25/2016
WRIGHT-PIERCE 	
Engineering a Better Environment	
FIGURE: 1	