


Figure 1. Proposed project areas for DWSRF project No. 2012 116001a Water Main Replacement
 Town of Putnam WPCA Public Water System

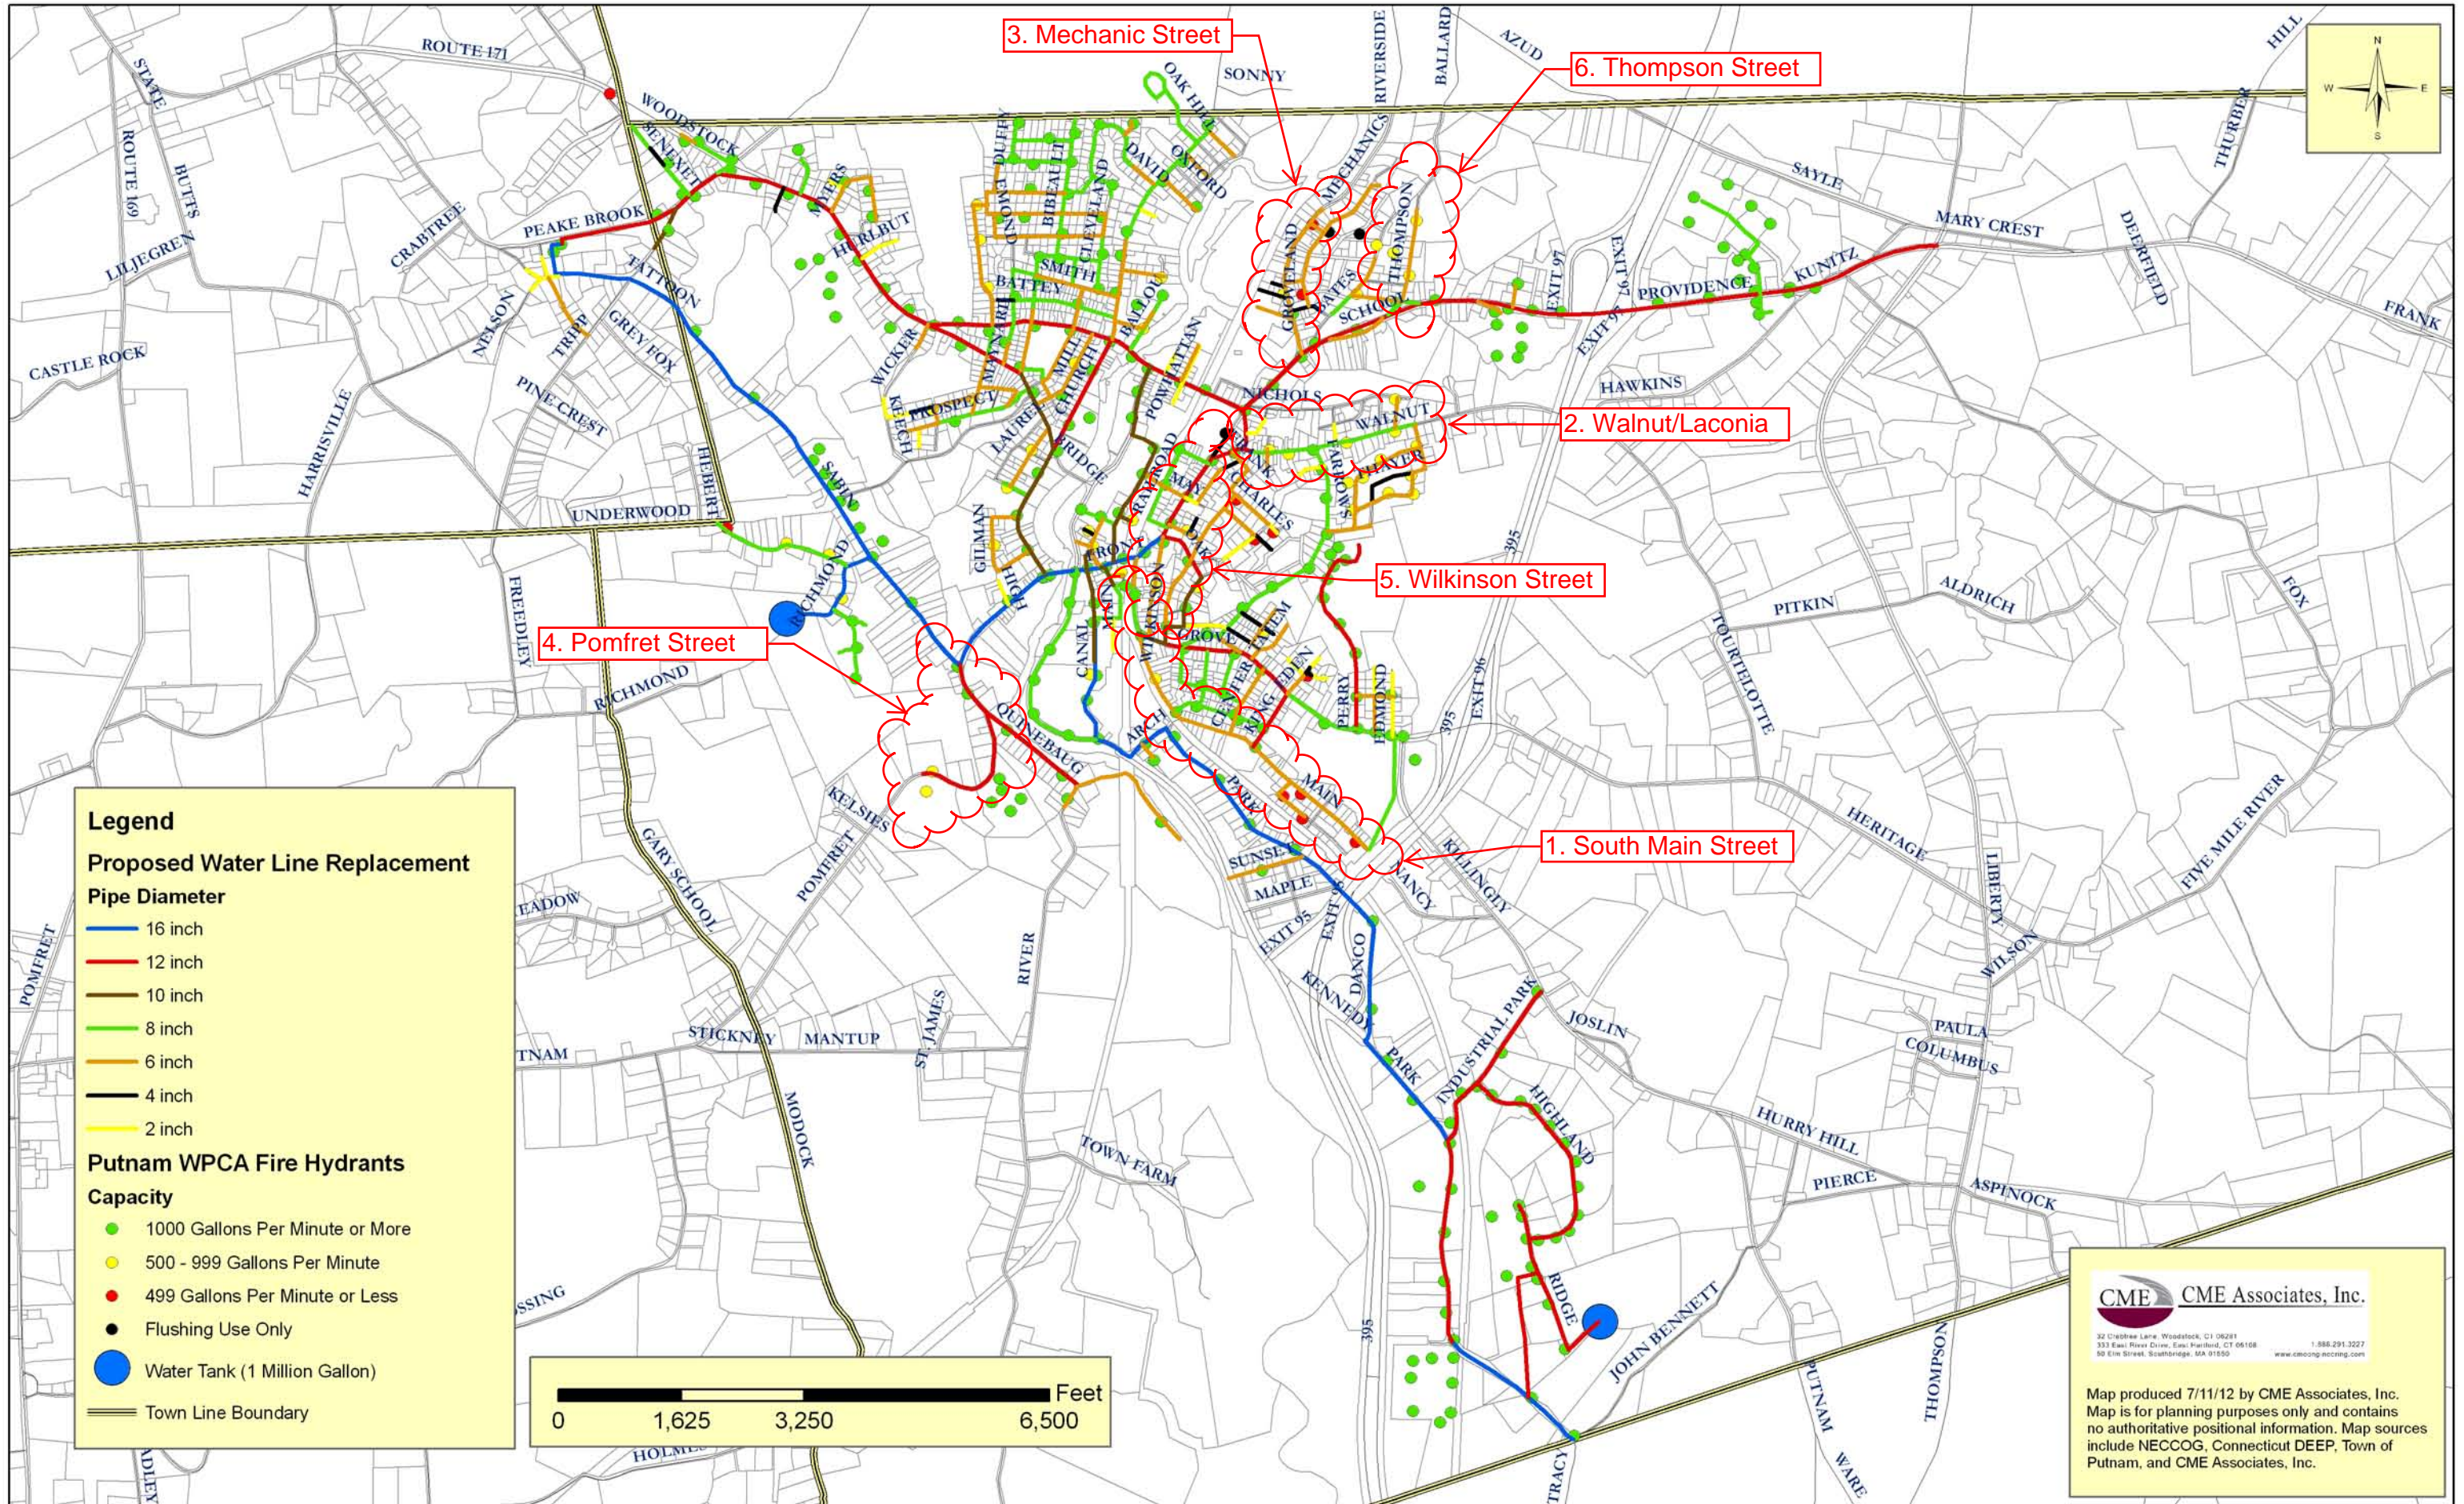

Legend


Proposed Water Line Replacement Pipe Diameter

- 16 inch
- 12 inch
- 10 inch
- 8 inch
- 6 inch
- 4 inch
- 2 inch

Putnam WPCA Fire Hydrants Capacity

- 1000 Gallons Per Minute or More
- 500 - 999 Gallons Per Minute
- 499 Gallons Per Minute or Less
- Flushing Use Only
- Water Tank (1 Million Gallon)

— Town Line Boundary

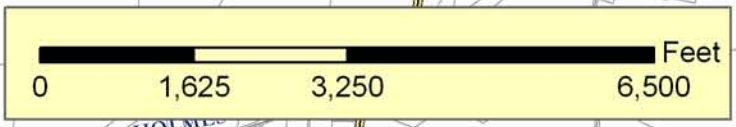

CME Associates, Inc.
 32 Chapel Lane, Woodstock, CT 06291
 333 East River Drive, East Fairfield, CT 06108
 90 Elm Street, Southbridge, MA 01550
 1.888.291.3227
 www.cmeassoc.com

Map produced 7/11/12 by CME Associates, Inc. Map is for planning purposes only and contains no authoritative positional information. Map sources include NECCOG, Connecticut DEEP, Town of Putnam, and CME Associates, Inc.